PRODUCT INFORMATION PACKET



Model No: 215TTGND6526 Catalog No: U007B

Hazardous Duty® Explosion Proof Motor, 10 HP, 3 Ph, 60 Hz, 230/460 V, 1800 RPM, 215T Frame, EPFC



Regal and Marathon are trademarks of Regal Rexnord Corporation or one of its affiliated companies.

©2024 Regal Rexnord Corporation, All Rights Reserved. MC017097E






Nameplate Specifications


Phase	3	Output HP	10 Hp		
Output KW	7.5 kW	Voltage	230/460 V		
Speed	1765 rpm	Service Factor	1.15		
Frame	215T	Enclosure	Explosion Proof Fan cooled		
Thermal Protection	Thermostat	Efficiency	91.7 %		
Ambient Temperature	40 °C	Frequency	60 Hz		
Current	26.6/13.3 A	Power Factor	76.9		
Duty	Continuous	Insulation Class	F		
Design Code	В	KVA Code	Н		
Drive End Bearing Size	6307	Opp Drive End Bearing Size	6208		
UL	UL Listed; also, UL Certified for Canada	CSA	N		
CE	N	IP Code	54		
Number of Speeds	er of Speeds 1		EXP PROOF CL I GR C&D CL II GR F&G T3B		

Technical Specifications

Electrical Type	Squirrel Cage Inverter Rated	Starting Method	Line Or Inverter		
Poles	4	Rotation	Reversible		
Resistance Main	.941 Ohms	Mounting	Rigid Base		
Motor Orientation	Horizontal	Drive End Bearing	Ball		
Opp Drive End Bearing	Ball	Frame Material	Cast Iron		
Shaft Type	Т	Overall Length	22.63 in		
Frame Length	12.12 in	Shaft Diameter	1.375 in		
Shaft Extension	3.38 in	Assembly/Box Mounting	F1 ONLY		
Inverter Load	CONSTANT 10:1				
Outline Drawing	037660-1212	Connection Drawing	A-EE7308T		

This is an uncontrolled document once printed or downloaded and is subject to change without notice. Date Created:09/07/2024

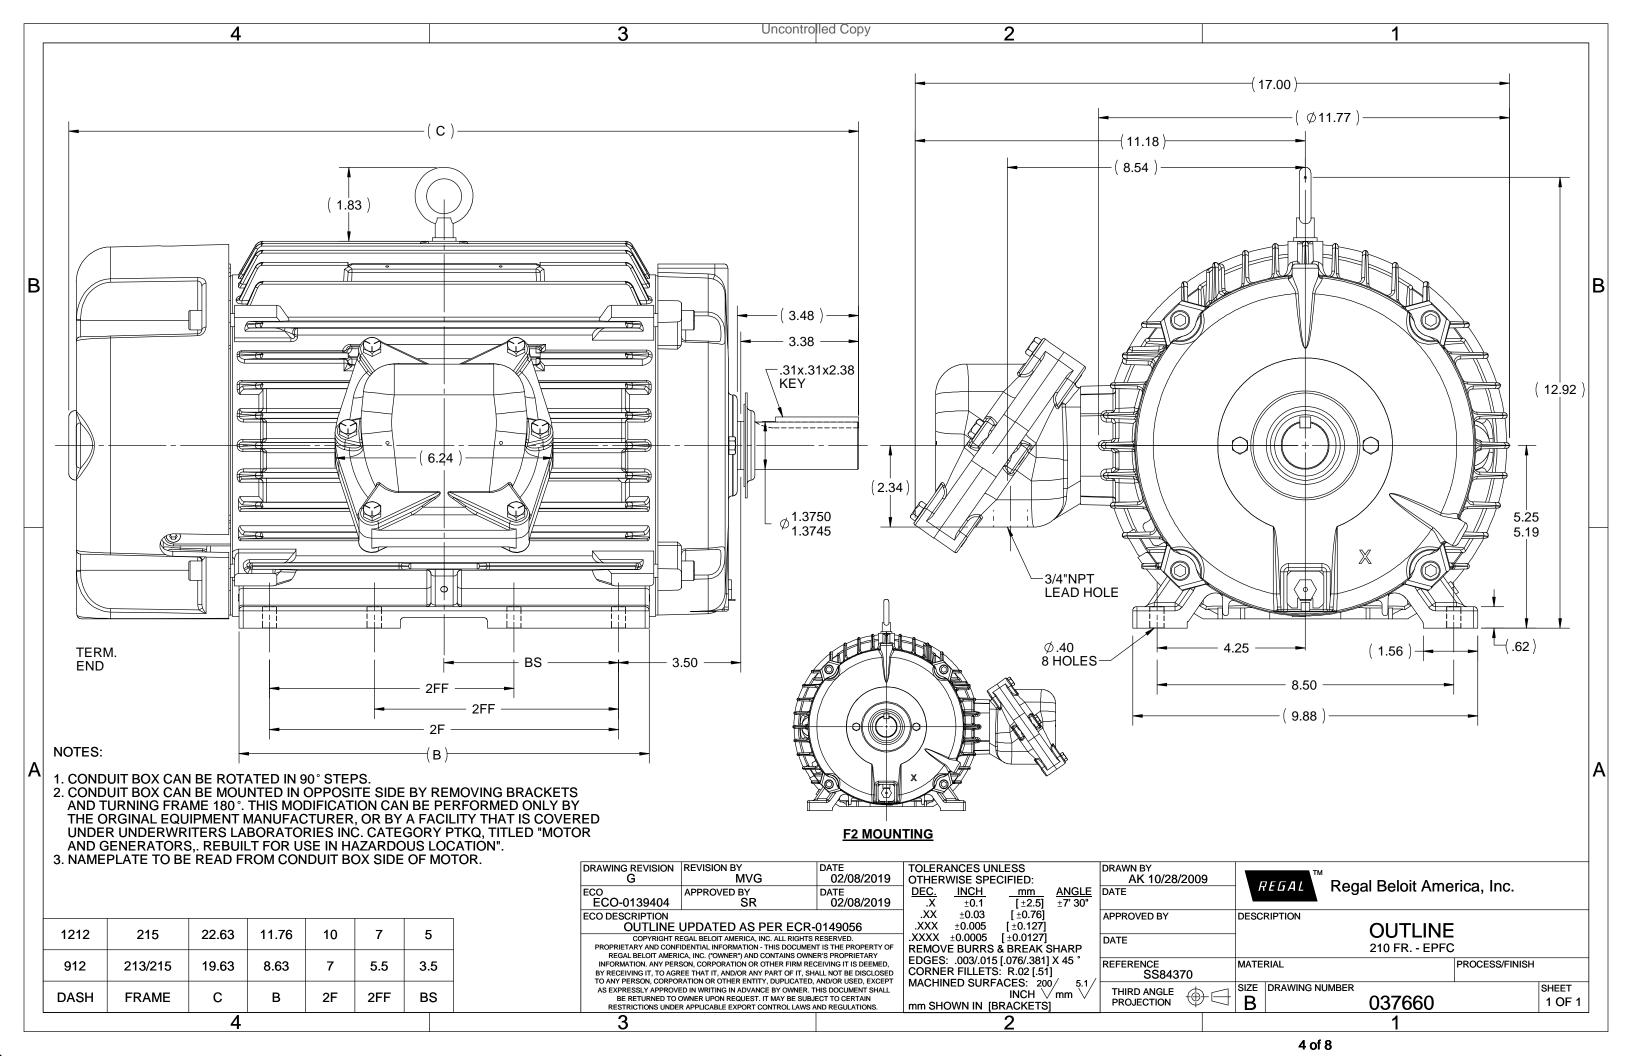

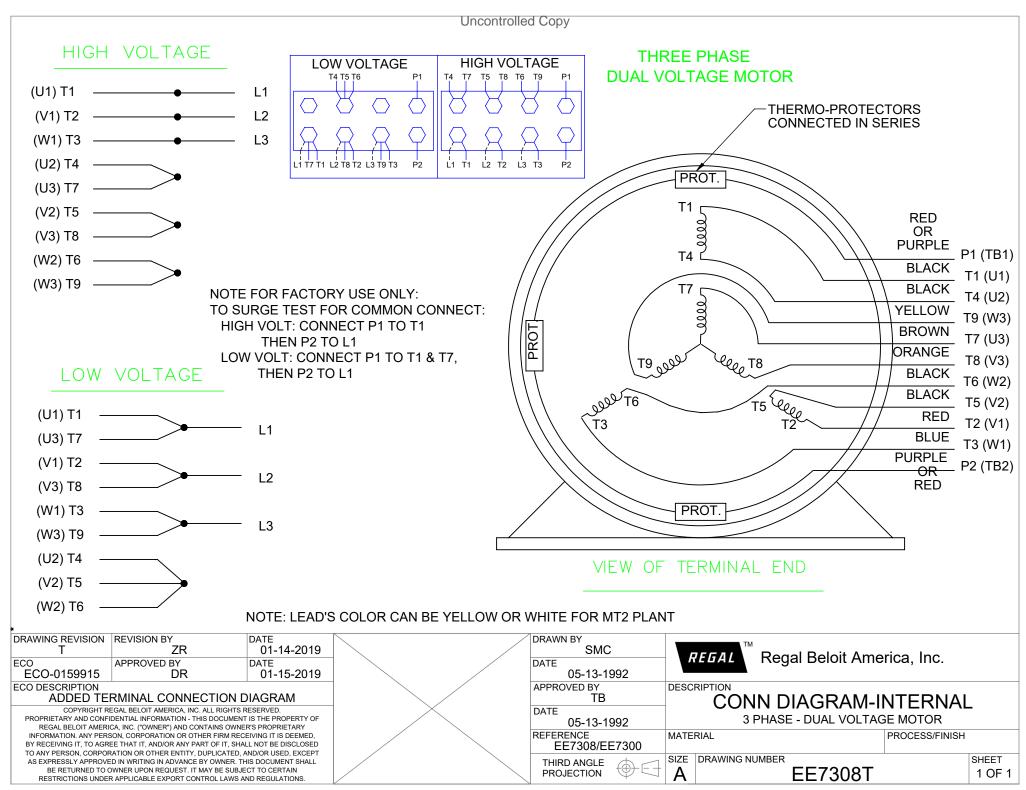


				<u>•</u> r	nar	atho elect	ON®		P.O. BOX 80 WAUSAU, W PH. 715-675	I 54401-8003	460		
				CEI	RTIFICA	TION DA	TA SHE	ET					
CUSTOME ORDER #: CONN. DIA OUTLINE: WINDING: SPEED:	: AGRAM: :	A-EE7308T 037660-1212 K2154512			. мото	r PERFO	CUSTO	DMER P.O. #: CE MODEL #: CAT #: MER PART #: MOUNTING:	U	526 007B		! - !	
НР	KW	SYNC RPM	FL R	RPM	FF	RAME	ENC	LOSURE	TYPE	KVA CO	DE	DESIGN	
10	7.5	1800	176	65	215T		TEFC		TFN	Н		В	
PH 3	HZ 60/50	VOLTS 230/460#190/380	AM 26.6/13.38			RT TYPE		OUTY	INSL F	S.F. 1.15	AMB 40	ELEV. 3300	
	F.L. EFF F.L. PF		3/4 LD EFF 3/4 LD PF			1/2 LD EFF 1/2 LD PF		GTD EFF 90.2		ELECT. TY SQ CAGE INV			
F.L. T	ORQUE	LR AMPS @	460 V	460 V L.R. TORQUE		B.D. TORQU		UE F.L. RISE (°C)		(°C)			
29.8	LB-FT	81.0		71.0 LB-FT 238°		238%	89.0 LB-FT		299% 55				
@3	@ 3 FT. POWER ROTOR WK		R WK ²	MAXI	OAD WK ²	2 SAFE STALL TIME		STARTS/HOUR		мото	R WGT		
62	dBA	71 dBA	1.00	LB-FT ²	277	LB-FT ²	25	SEC.	0.7	2	150 LB.		
			`										
		ODE BRACKET	MOUNT		TOR	NTAL INFO		ARDOUS	DRIP	1	l		
DE BRAC	KET TYPE	TYPE	TYPE	_	TATION	-		CATION	COVER	SCREENS	PA	AINT	
STAN	NDARD	STANDARD	RIGID	HORIZ	ZONTAL	TRUE	DF CL I GR C&D CL II GF		NO	NONE	BLUE ((EPOXY)	
DEAL	RINGS	ı	ı		ı				I				
DE	ODE	GREASE	SHAFT	TYPE	SPE	CIAL DE	SPEC	CIAL ODE	SHAFT	MATERIAL	FRAME N	MATERIAL	
BALL 6307	BALL BALL POLYBEX EM		Т		NONE		NONE		1045 HOT ROLLED (C-204)		CAST IRON		
THERMOSTATS PROTECTORS		PROTECTORS	WDG I	/DG RTD's BRG RTD's		THERMISTORS		CONTROL		SPACE HEATERS			
TSTAT	ΓS (N/C)	NOT	NO	NE	N	IONE	N	IONE	F	ALSE	N	NΑ	
D1 /ak	/ l-\	DO (ahma/ah)	V1 /aha		V0 (-	hman/mb\	V /	- h	VIDDAT	ION (in/occ)			
R1 (ohms/ph) 0.612		R2 (ohms/ph) X1 (ohms/ph) 0.457 1.855		X2 (ohms/ph) Xm (ohms/ph 2.156 35.888			VIBRATION (in/sec) 0.150		FLOAT ODE				
	012	0.407	1.0		-			0.000	<u> </u>		Ŭ	<u> </u>	
* N O T								INV. HP SPI	EED RANGE:	CONSTANT 10: NONE	1		
E S *							-	ENCODER: NONE NONE	NONE		NONE	: PPR	
PREP		FAREEDA DUDEKUL	A					BRAKE: NO FT-LB:	NE	NONE			


FORM: 3531 REV_4 2/27/06

VOLTAGE:

NONE

HZ:

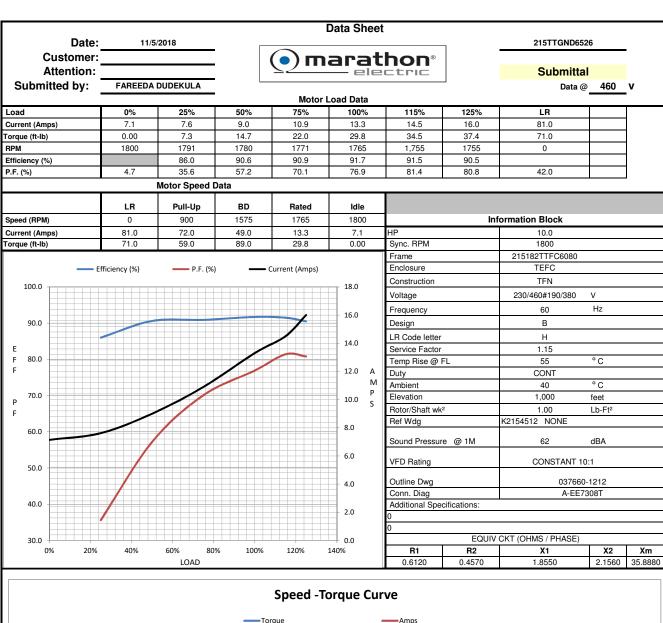

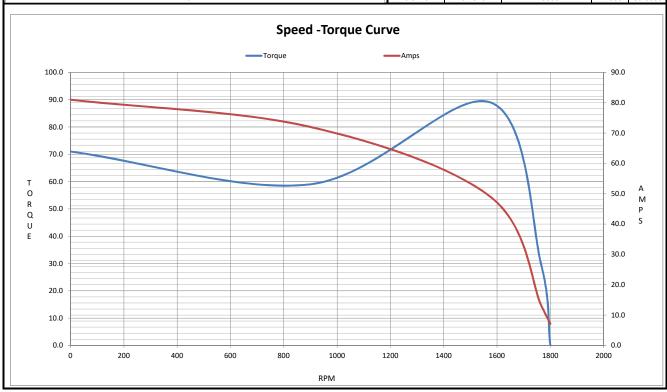

CERTIFICATE OF COMPLIANCE

Certificate Number
Report Reference

20220225- E12044 E12044-20090313

Issue Date

2022-FEBRUARY-25

Issued to:

REGAL BELOIT AMERICA INC

1946 W COOK RD

FORT WAYNE IN 46818

Tradename: Marathon

This certificate confirms that representative samples of

MOTORS FOR USE IN HAZARDOUS LOCATIONS

Electric motors for use in hazardous locations; Class I, Groups C and D; Class II, Groups F and G; Inclusive of Model Number 215TTGND6526 (may have prefix and/or

suffix characters).

Have been investigated by UL in accordance with the

Standard(s) indicated on this Certificate.

Standard(s) for Safety:

UL 674 - Electric Motors and Generators for Use in Division

1 Hazardous (Classified) Locations,

CSA C22.2 No. 145, Electric Motors and Generators for

Use in Hazardous (Classified) Locations

Additional Information:

See the UL Online Certifications Directory at

https://iq.ulprospector.com for additional information.

This *Certificate of Compliance* does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Bambles

Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, pleas contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

